


A step by step guide to calculating the ventilation requirements of gas appliances in Ireland



Extracts from the Building Regulations Technical Guidance Document Part J, table 4.
Information applies to fixed gas burning appliances with a rated input up to 70 kW.

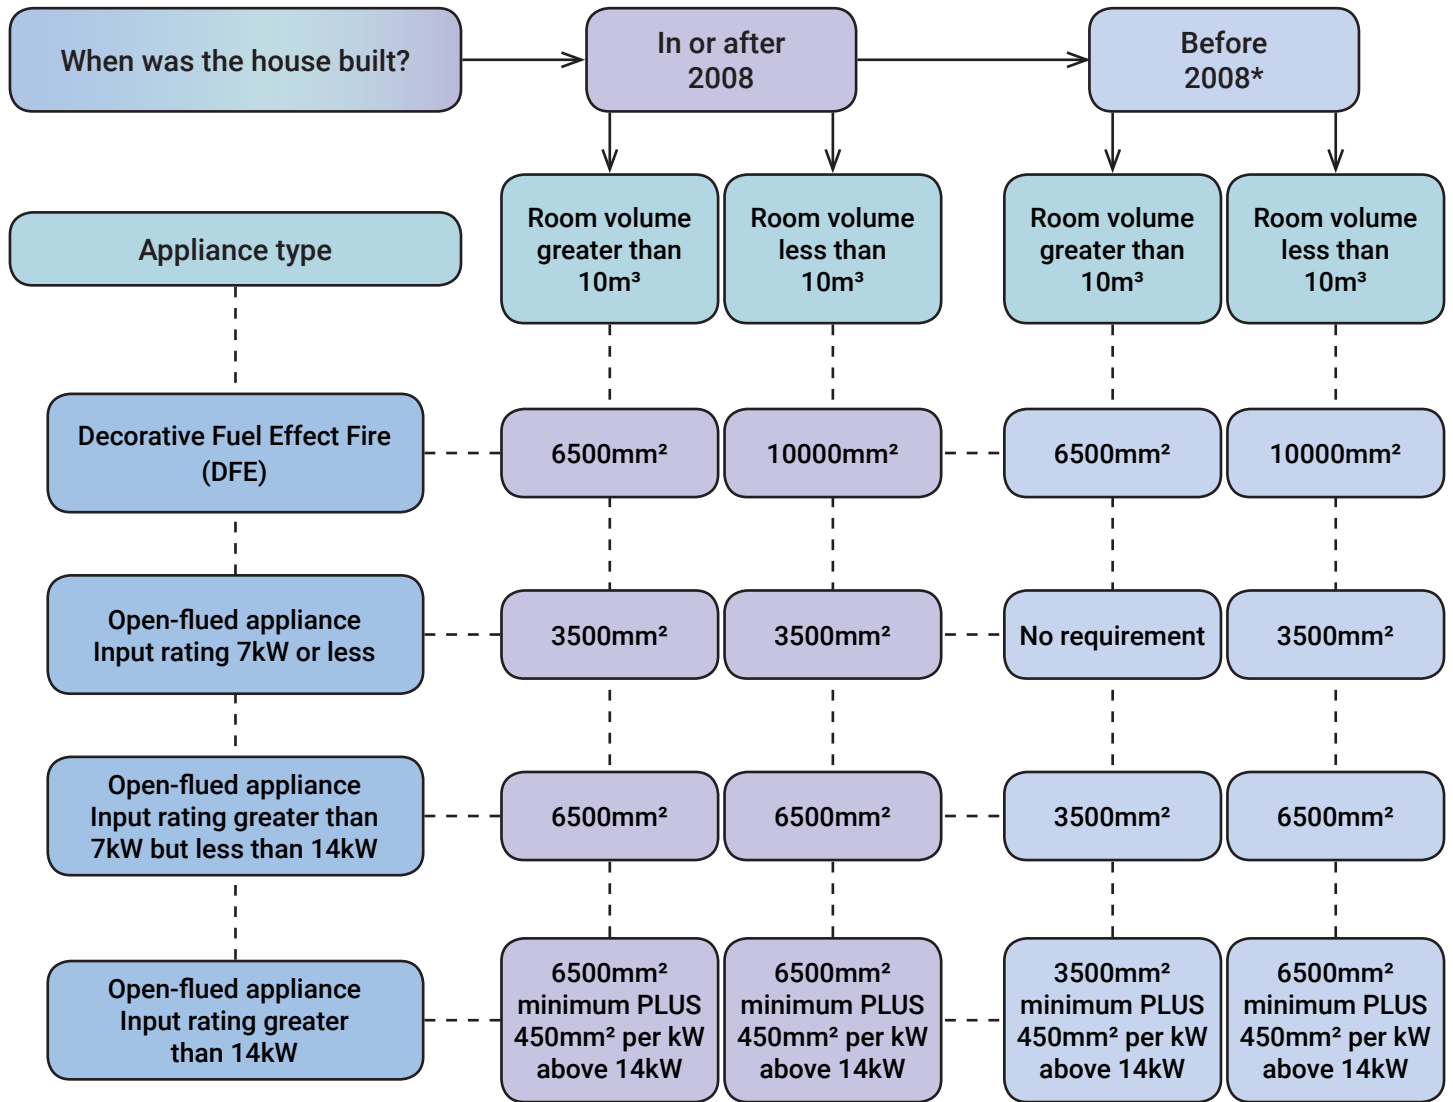

Can I use a closeable grille on the inside? → No

Can the vent incorporate a flymesh? → No

Is it safe to make my own vent using a tube with louvres either side? → No

See Rytons full range of vents for gas appliances at www.vents.co.uk.

* Refer to Appendix B of Technical Guidance Document Part J for measures that constitute significantly improving airtightness.