


A step by step guide to calculating the ventilation requirements of solid fuel appliances

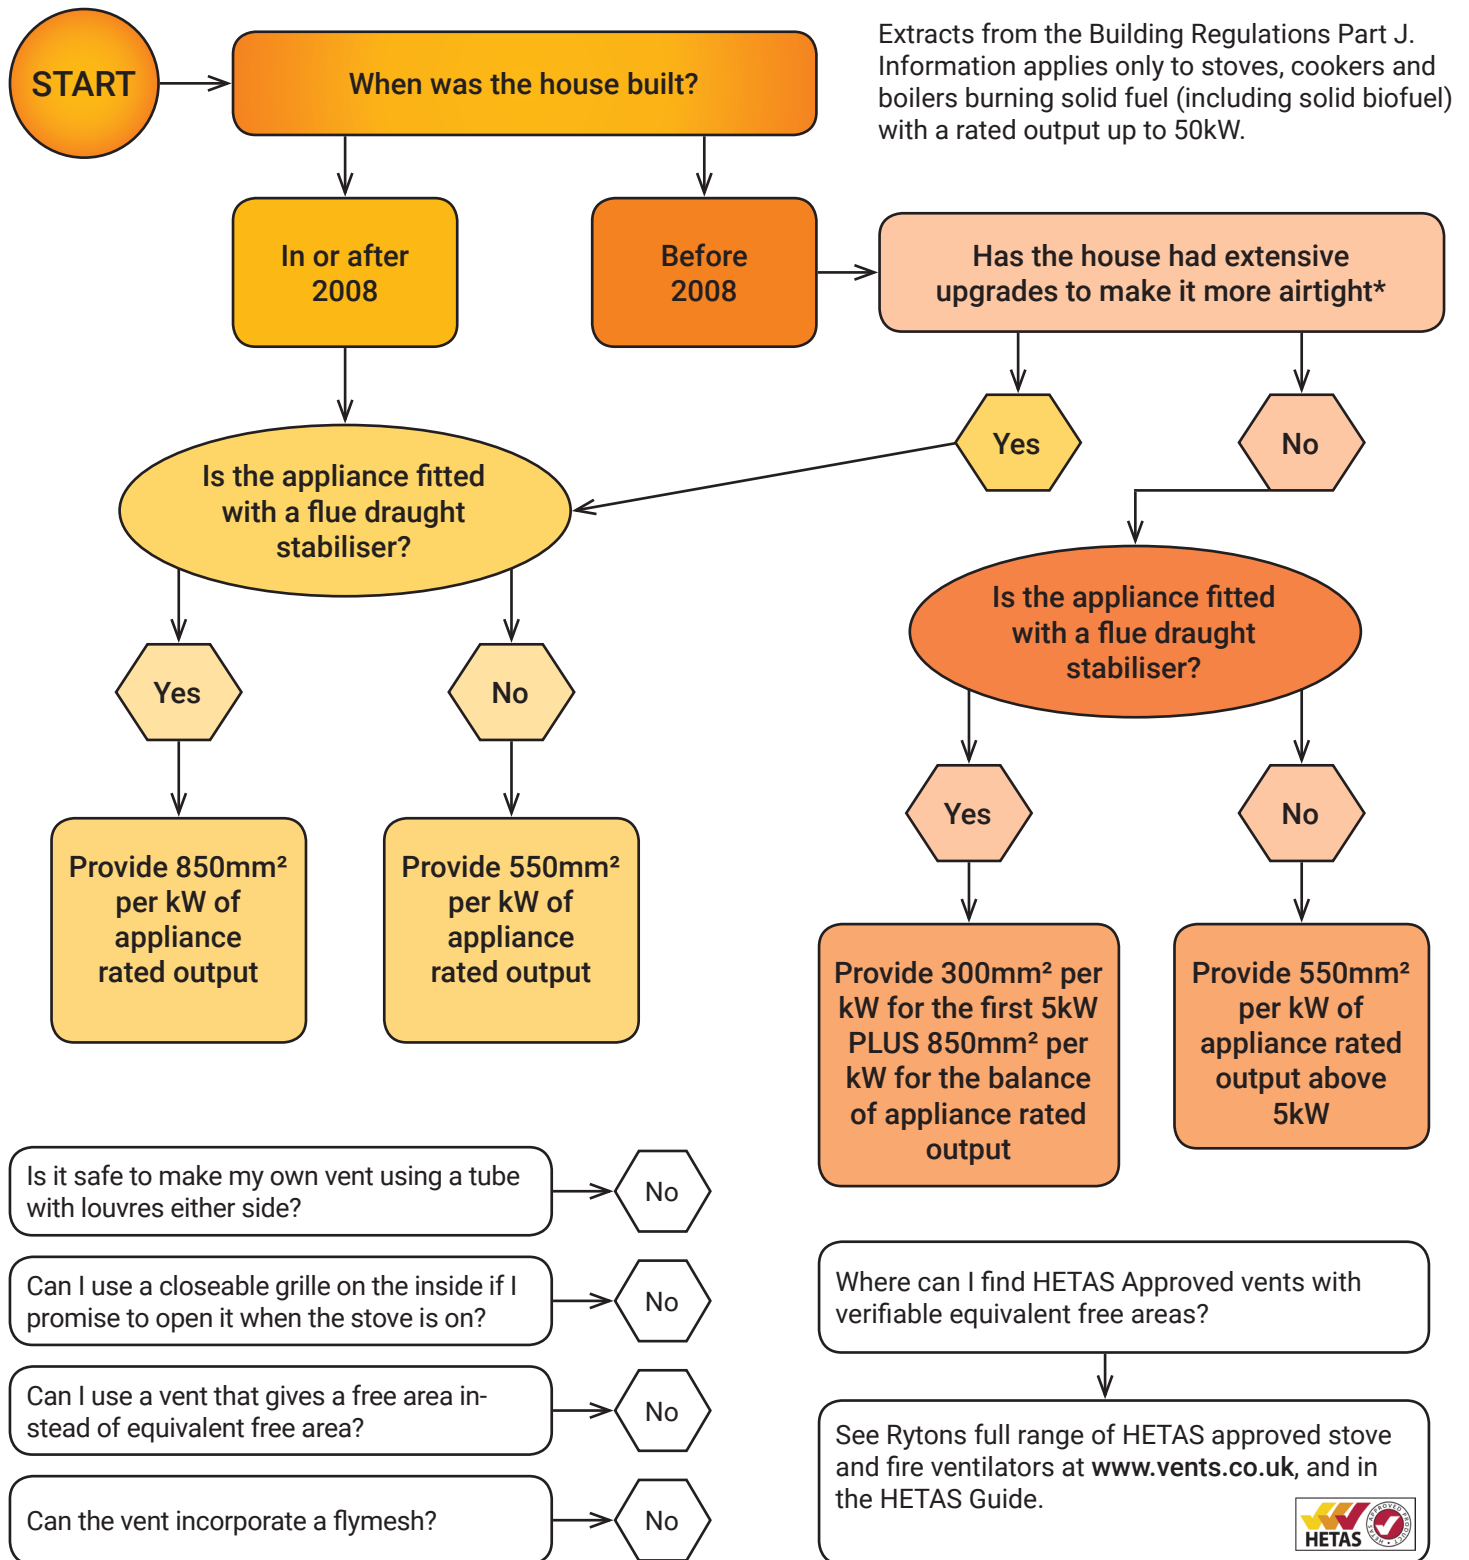

* Refer to Appendix F of the Building Regulations Part J for measures that constitute significantly improving airtightness.